

# EU-TYPE EXAMINATION CERTIFICATE

**Foxytech Sp.z.o.o.**  
ul.wokulskiego 11 58-100 Swidnica  
Poland

EU-Type Examination

Certificate No.

**1695-22**

Revision 3



**Type** S34U28  
**Object** Electronic three-phase four-wire energy meter.  
Direct connected

The object has been assessed and meets the requirements of

**EU Directive 2014/32/EU**,  
Module B

The energy meter(s) meet(s) the essential requirements of Annex V of EU Directive 2014/32/EU, on the harmonization of the laws of Member States relating to the making available on the market of measuring instruments (recast).

This Certification is based on the report(s) listed in the report list in this Certificate.

This Certificate is valid until: November 14, 2033

This Certificate comprises 8 pages in total.

Issued by KEMA B.V.  
Klingelbeekseweg 195,  
Arnhem, The Netherlands  
Notified Body 2290

Alessandro Bertani  
Director,  
Services & Smart Technologies

Arnhem, November 14, 2023



### REVISION OVERVIEW

The highest revision always replaces the earlier issued versions.

Rev. No.	Date of issue	Reason
0	November 2, 2022	First issue
1	November 2, 2022	Typo corrected
2	November 2, 2022	Typo corrected
3	November 14, 2023	New variant of the meter added

### REPORT LIST

This Certificate is issued based on the following reports.


Report number	revision
1698-22	R2
1699-22	R2
1659-23	R0

An assessment was conducted on a sample provided by Foxytech Sp.z.o.o. where it was concluded that the sample issued by Foxytech Sp.z.o.o. is identical to the reported samples. Therefore, the results in the listed reports are also valid for Foxytech Sp.z.o.o. and can be used as evidence for this certificate.


## 1 TECHNICAL DATA

Manufacturer	Foxytech Sp.z.o.o. ul.wokulskiego 11 58-100 Swidnica, Poland		
Production location	Foxytech Sp.z.o.o. ul.Kraszowicka 72 58-100 Swidnica, Poland		
Type	S34U28		
Connection	Direct		
Type of circuit	3P4W		
Accuracy class Wh	1/B		
Accuracy class varh	1 and 2		
Meter constant	1000 imp/kWh 1000 imp/kvarh		
V range	230/400 V		
I range $I_{min}$ - $I_n$ ( $I_{max}$ )	0,25-5(100) A		
Frequency	50 Hz		
Temperature range	-40 .. 70 °C		
Use	Indoor		
IP rating	IP54		
Protection Class	II		
Impulse voltage	6 kV		
Internal clock	Crystal controlled		
Environmental class	M1, M2, E1 and E2, CISPR32 class B		
Utilisation category	UC3		
LR Firmware ID	V0.09.10		
LR Firmware CRC	265A		
Register	LCD		
Registry method(s):	Vectoral computation method		

**2 PHOTOGRAPHS AND SEALING**

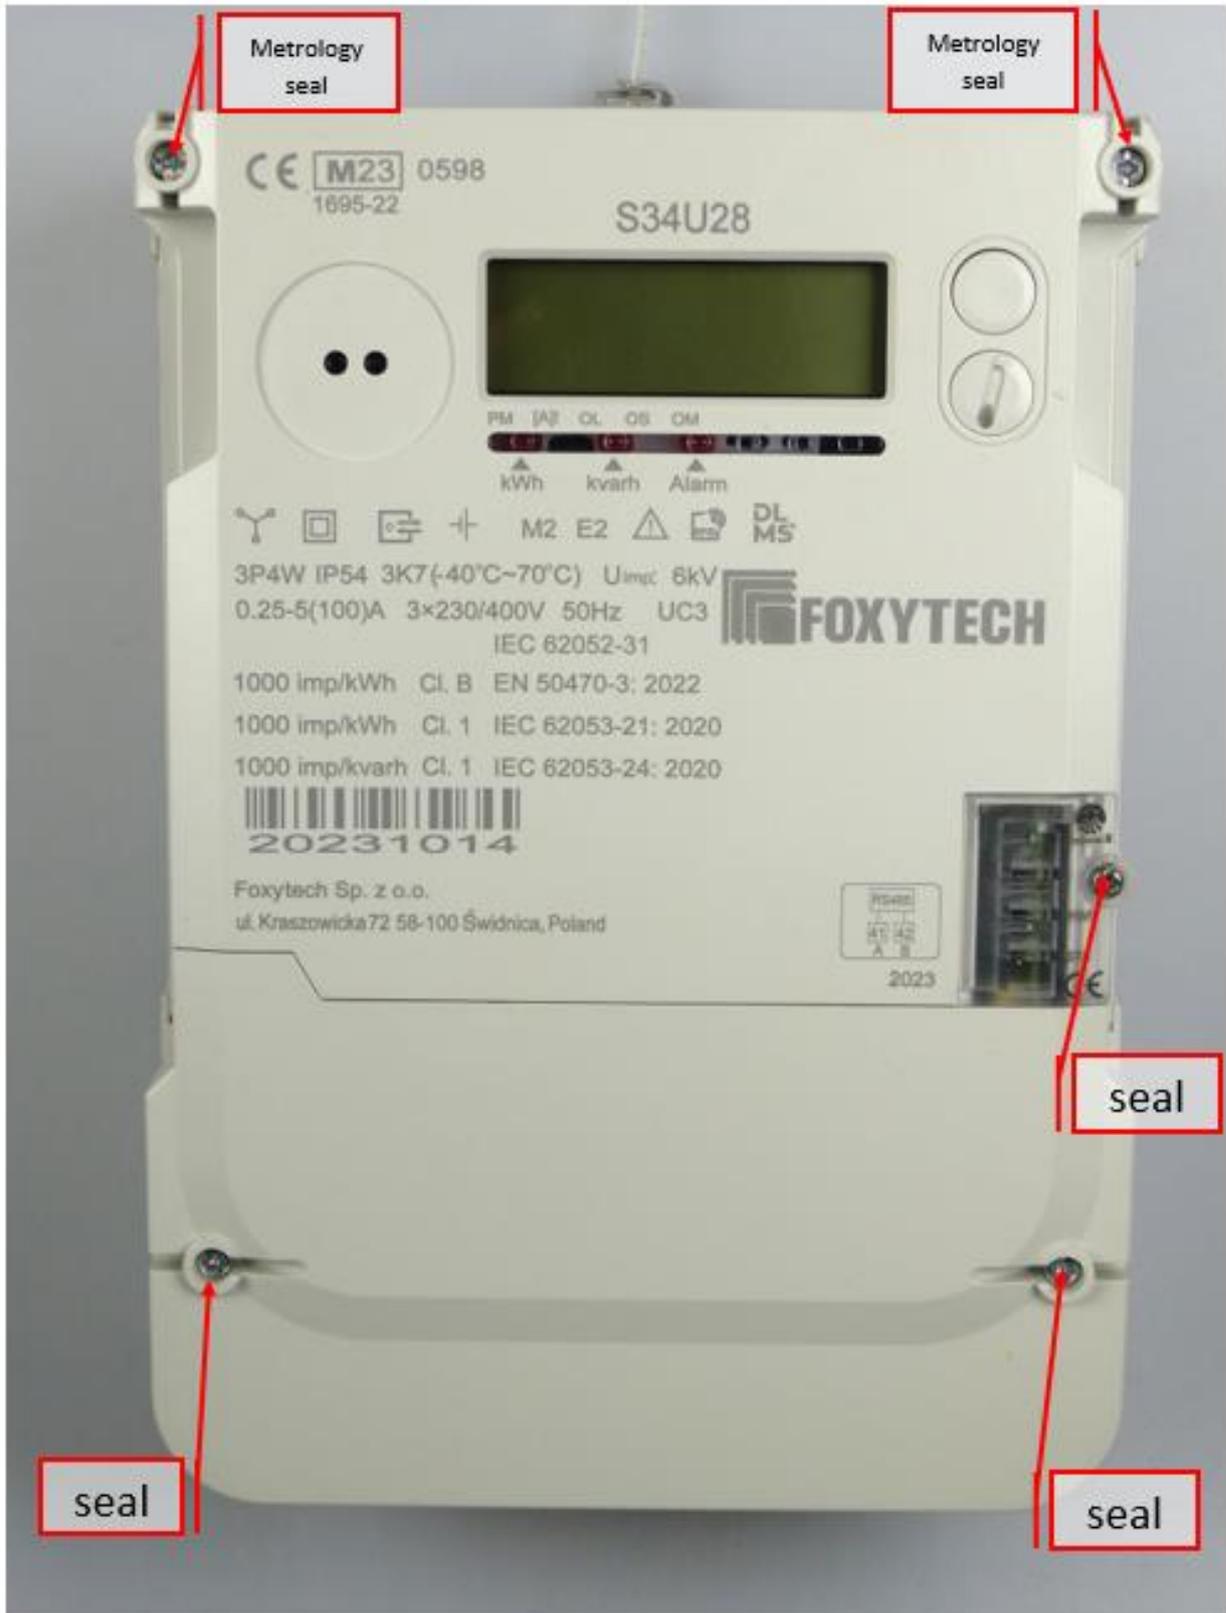

**3 EXAMPLES OF NAME PLATES**

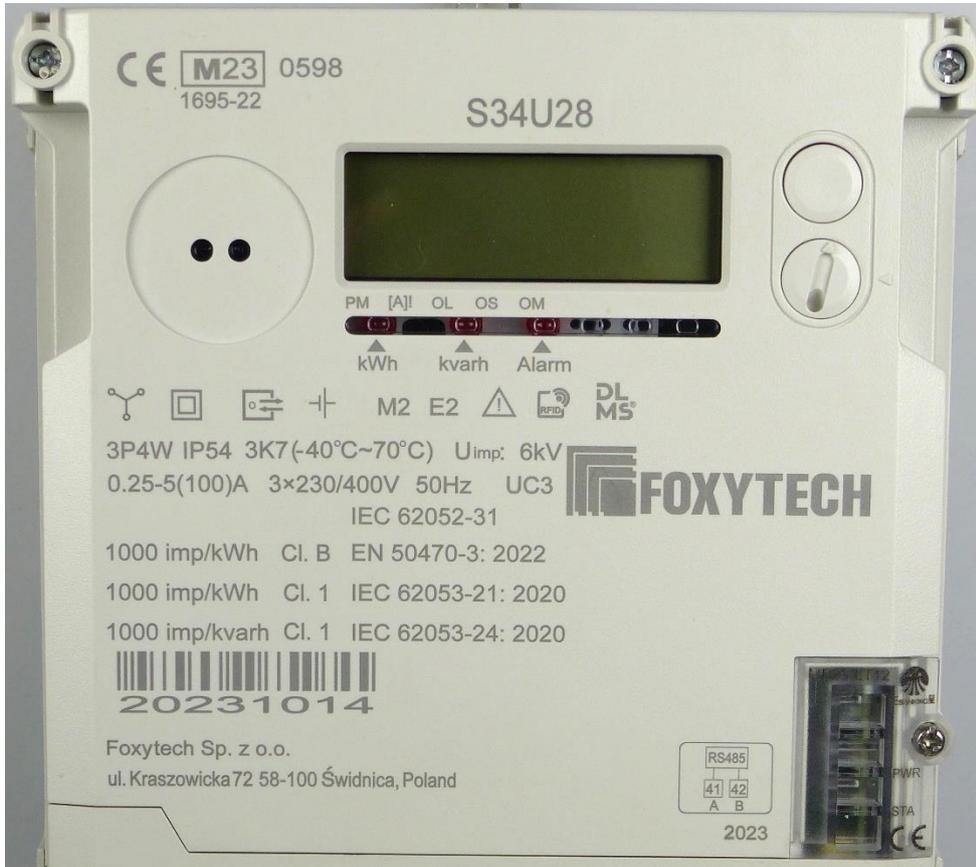

#### 4 CALCULATION OF THE COMPOSITE ERROR / MPE

During the type approval test the intrinsic errors for temperature, voltage and frequency variation are determined per load point. The composite error is determined with the following formula:

$$\varepsilon_m = \sqrt{\varepsilon^2(I, \cos\varphi) + \delta^2(T, I, \cos\varphi) + \delta^2(U, I, \cos\varphi) + \delta^2(f, I, \cos\varphi)}$$

Where

$\varepsilon^2(I, \cos\varphi)$  = Intrinsic error of the meter at a certain load

$\delta^2(T, I, \cos\varphi)$  = Additional error due to the variation of the temperature at the same load

$\delta^2(U, I, \cos\varphi)$  = Additional error due to the variation of the voltage at the same load

$\delta^2(f, I, \cos\varphi)$  = Additional error due to the variation of the frequency at the same load

Results are in the table below:

Current	cosφ	Phase	Composite error							
			-40°C	-25°C	-10°C	5°C	30°C	40°C	55°C	70°C
Imin	1	3ph	0,33%	0,23%	0,14%	0,10%	0,10%	0,10%	0,14%	0,21%
Itr	1	3ph	0,33%	0,22%	0,13%	0,10%	0,09%	0,10%	0,13%	0,20%
Itr	1	1ph,1	0,31%	0,20%	0,13%	0,10%	0,09%	0,10%	0,13%	0,20%
Itr	1	1ph,2	0,31%	0,22%	0,14%	0,11%	0,11%	0,12%	0,16%	0,23%
Itr	1	1ph,3	0,35%	0,23%	0,12%	0,08%	0,06%	0,07%	0,11%	0,17%
Itr	0,5i	3ph	0,32%	0,22%	0,11%	0,07%	0,06%	0,08%	0,14%	0,24%
Itr	0,5i	1ph,1	0,32%	0,23%	0,11%	0,06%	0,05%	0,07%	0,13%	0,22%
Itr	0,5i	1ph,2	0,30%	0,18%	0,11%	0,07%	0,07%	0,09%	0,16%	0,25%
Itr	0,5i	1ph,3	0,34%	0,22%	0,10%	0,03%	0,02%	0,03%	0,09%	0,18%
Itr	0,8c	3ph	0,36%	0,27%	0,20%	0,17%	0,17%	0,17%	0,20%	0,24%
In	1	3ph	0,32%	0,22%	0,14%	0,10%	0,09%	0,10%	0,14%	0,21%
In	1	1ph,1	0,32%	0,22%	0,13%	0,10%	0,09%	0,10%	0,14%	0,21%
In	1	1ph,2	0,32%	0,22%	0,15%	0,11%	0,11%	0,12%	0,16%	0,24%
In	1	1ph,3	0,35%	0,23%	0,13%	0,09%	0,08%	0,09%	0,13%	0,19%
In	0,5i	3ph	0,32%	0,21%	0,11%	0,07%	0,06%	0,07%	0,13%	0,22%
In	0,5i	1ph,1	0,32%	0,21%	0,10%	0,07%	0,06%	0,07%	0,12%	0,21%
In	0,5i	1ph,2	0,30%	0,20%	0,11%	0,08%	0,08%	0,10%	0,15%	0,24%
In	0,5i	1ph,3	0,33%	0,21%	0,10%	0,06%	0,04%	0,05%	0,10%	0,18%
In	0,8c	3ph	0,33%	0,23%	0,15%	0,12%	0,11%	0,11%	0,15%	0,21%
Imax	1	3ph	0,33%	0,22%	0,14%	0,11%	0,10%	0,11%	0,15%	0,22%
Imax	1	1ph,1	0,32%	0,21%	0,14%	0,12%	0,11%	0,12%	0,16%	0,22%
Imax	1	1ph,2	0,34%	0,25%	0,18%	0,16%	0,15%	0,16%	0,20%	0,26%
Imax	1	1ph,3	0,35%	0,23%	0,15%	0,11%	0,10%	0,11%	0,14%	0,21%
Imax	0,5i	3ph	0,37%	0,31%	0,25%	0,22%	0,25%	0,25%	0,26%	0,39%
Imax	0,5i	1ph,1	0,34%	0,26%	0,21%	0,20%	0,19%	0,20%	0,24%	0,31%
Imax	0,5i	1ph,2	0,29%	0,32%	0,23%	0,24%	0,25%	0,28%	0,24%	0,39%
Imax	0,5i	1ph,3	0,38%	0,29%	0,24%	0,23%	0,23%	0,23%	0,25%	0,34%
Imax	0,8c	3ph	0,34%	0,17%	0,14%	0,11%	0,10%	0,10%	0,15%	0,19%
<b>Requirements</b>										
Imin	1	3ph	4,00%	3,50%	2,50%	2,00%	2,00%	2,50%	3,50%	4,00%
>Imin	Any	3ph	4,00%	3,50%	2,50%	2,00%	2,00%	2,50%	3,50%	4,00%
>Imin	Any	1ph	4,50%	4,00%	3,00%	2,50%	2,50%	3,00%	4,00%	4,50%

## 5 OPTIONS AND VARIANTS

Overview of variants and options with details

Type designation	Details of the meter
S34U28	<ul style="list-style-type: none"><li>- Communication options:<ul style="list-style-type: none"><li>optical port</li><li>RS485</li><li>PLC</li></ul></li><li>- Supply control switch</li></ul>

## END OF DOCUMENT

The laboratories of KEMA Labs are:

- CESI S.p.A., Milan, Italy.
- FGH Engineering & Test GmbH, Mannheim, Germany.
- IPH Institut "Prüffeld für elektrische Hochleistungstechnik" GmbH, Berlin, Germany.
- KEMA B.V., Arnhem, The Netherlands.
- KEMA Labs, Zkušebnictví, a.s., Prague, the Czech Republic.
- KEMA-Powertest, LLC, Chalfont, United States.